




EM ... SELFTEST emergency module wiring diagrams  
Not for use with magnetic ballasts and switch start circuits

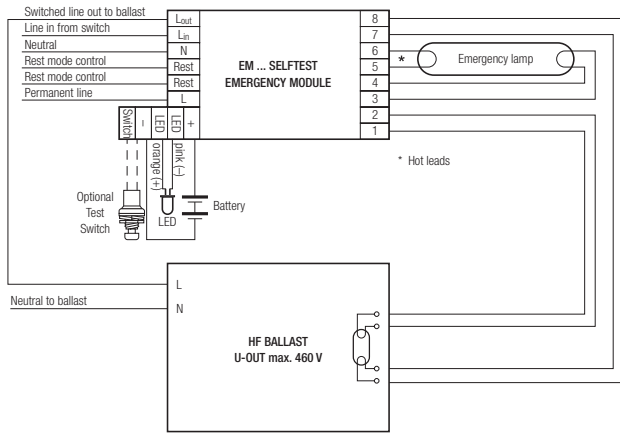


Wiring diagram for single lamp high frequency ballasts

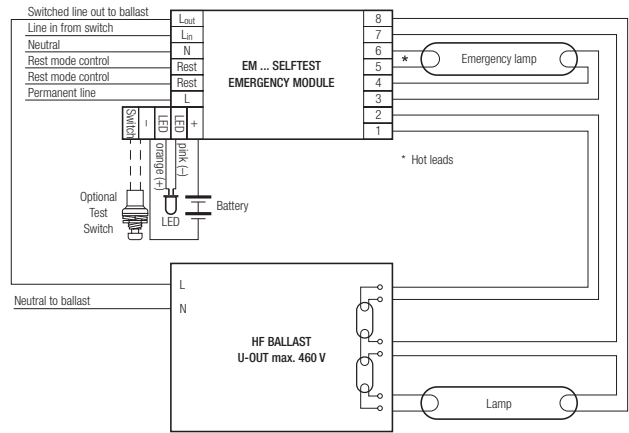


Wiring diagram for twin lamp high frequency ballasts with 6 terminals

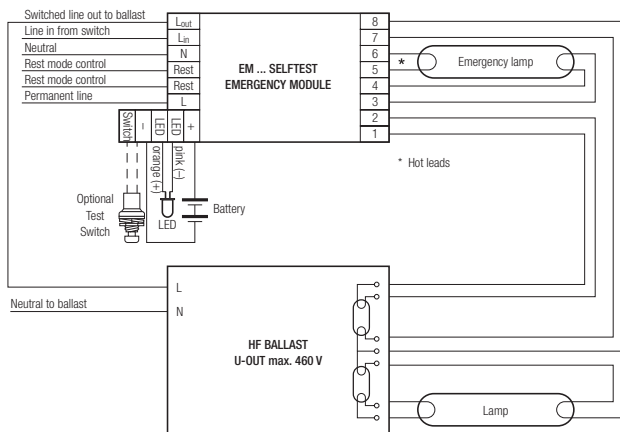

Wiring diagram for twin lamp high frequency ballasts with 7 terminals

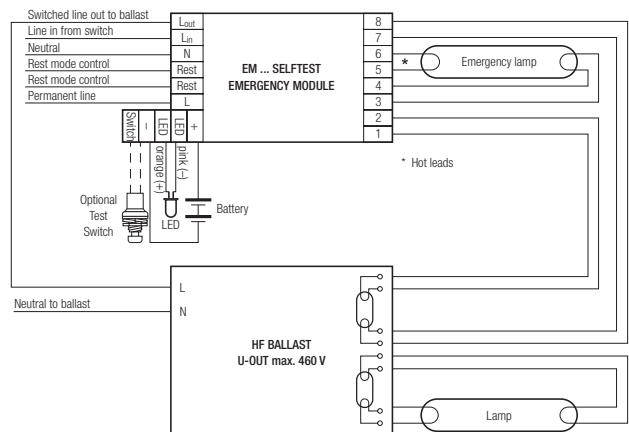

Wiring diagram for twin lamp high frequency ballasts with 8 terminals

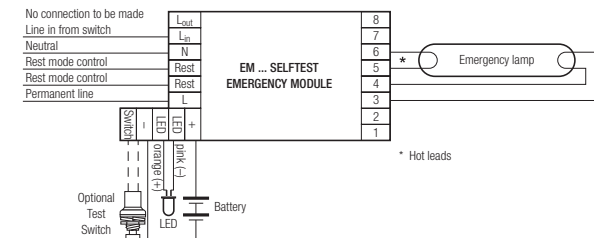

Wiring diagram for non-maintained operation

**Note:** All hot leads normally marked with an \* should be kept as short as possible. For comprehensive wiring diagrams and instructions consult the Tridonic website [www.tridonic.com](http://www.tridonic.com)